


NOTE:
A MINIMUM OF 10 FEET OF HORIZONTAL CLEARANCE IS REQUIRED FROM UNDERGROUND SERVICES TO PERMANENT ABOVE GROUND FIXTURES SUCH AS TREES, UTILITY PEDESTALS, ETC.

PLAN VIEW

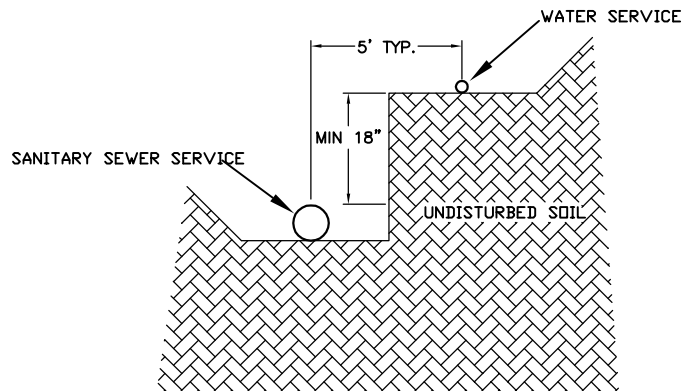

NOTE:
IF SANITARY SERVICE IS AT THE SAME ELEVATION AS THE WATER SERVICE, A HORIZONTAL SEPARATION OF 10 FEET SHALL BE MAINTAINED.

PROFILE VIEW

WATER & SANITARY SEWER SERVICE SEPARATION DETAIL

NOT TO SCALE
PLATE 6005

WATER & SANITARY SEWER SERVICE SEPARATION DETAIL

STANDARD DETAIL
PLATE NO:
6005

APPROVED: ADOPTED BY CITY COUNCIL ON FEBRUARY 26, 2007

REVISED:

REMARKS:

SAINT PETER UTILITY STANDARD DETAIL

